


How to use the reserved 485 interface of the THENOW wine cellar air conditioner control terminal to connect with other control terminals for remote control?

Operation Guide:

Prerequisite: Ensure that the control port to be connected supports the 485 protocol.


Step 1: Identify the location of the 485 interface

The location of the 485 interface on the THENOW controller main board is shown in the diagram as **ports A2 and B2**

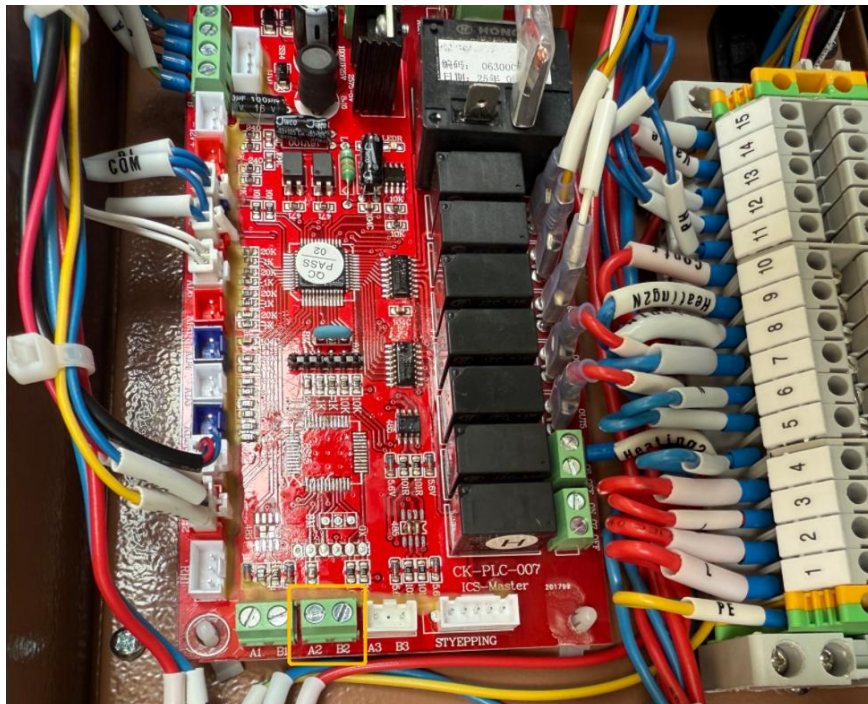

Step 2: Connect the 485 interface of the target control terminal using cables.

Step 3: Access the advanced parameters of the THENOW controller, locate the communication settings, and **update the address and baud rate** according to the data of the connected device. After a successful connection, the corresponding THENOW device will be displayed on the connected terminal.

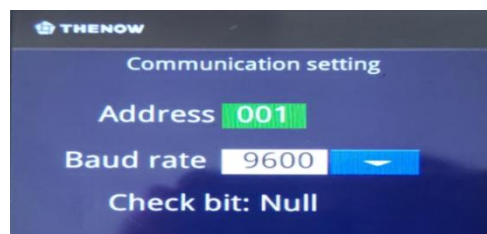

Step 4: Write the 485 communication protocol provided by THENOW into the connected device.